


UNIT	COOLING TOWER
MODEL #	AT 112-3K14


DWG. #	T3121436-DRE-ST	REV.	-
SERIAL #		DATE	1/31/2026

NOTES:  
 1. (M) FAN MOTOR LOCATION  
 2. HEAVIEST SECTION IS UPPER SECTION  
 3. MPT DENOTES MALE PIPE THREAD  
 FPT DENOTES FEMALE PIPE THREAD  
 BFW DENOTES BEVELED FOR WELDING  
 GVD DENOTES GROOVED  
 FLG DENOTES FLANGE  
 4. +UNIT WEIGHT DOES NOT INCLUDE  
 ACCESSORIES (SEE ACCESSORY DRAWINGS)  
 5. MAKE-UP WATER PRESSURE  
 20 psi MIN [137 kPa], 50 psi MAX [344 kPa]  
 6. 3/4" [19MM] DIA. MOUNTING HOLES.  
 REFER TO RECOMMENDED STEEL SUPPORT  
 DRAWING  
 7. DIMENSIONS LISTED AS FOLLOWS:  
 ENGLISH FT-IN  
 [METRIC] [mm]

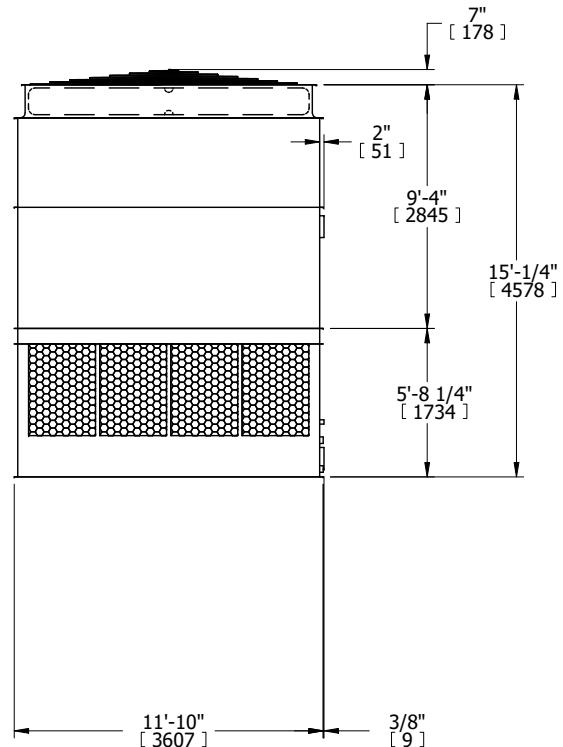


**FACE B**

**PLAN VIEW**

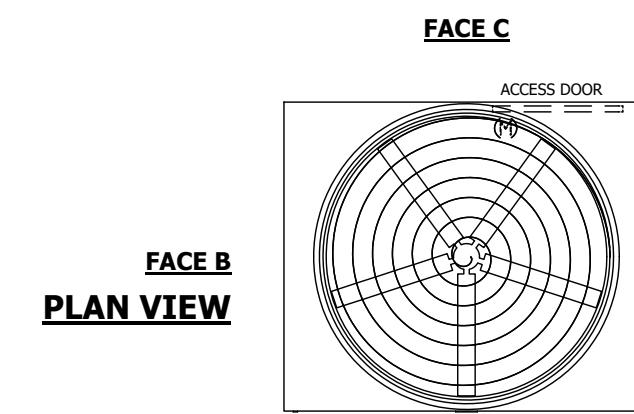

**FACE C**

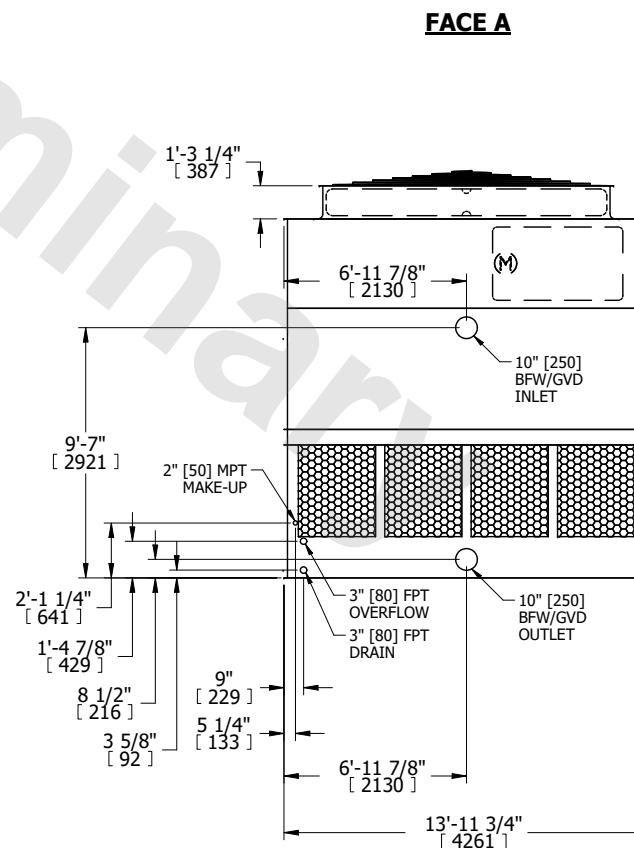

**FACE A**

**FACE D**