



UNIT	COOLING TOWER
MODEL #	AT 428-3K48

DWG. #	T4284836-DRA-ST	REV.	-
SERIAL #		DATE	1/30/2026



NOTES:  
1. (M)- FAN MOTOR LOCATION  
2. HEAVIEST SECTION IS UPPER SECTION  
3. MPT DENOTES MALE PIPE THREAD  
FPT DENOTES FEMALE PIPE THREAD  
BFW DENOTES BEVELED FOR WELDING  
GVD DENOTES GROOVED  
FLG DENOTES FLANGE  
PE DENOTES PLAIN END  
4. +UNIT WEIGHT DOES NOT INCLUDE  
ACCESSORIES (SEE ACCESSORY DRAWINGS)  
5. MAKE-UP WATER PRESSURE  
20 psi MIN [137 kPa], 50 psi MAX [344 kPa]  
6. 3/4" [19MM] DIA. MOUNTING HOLES. REFER TO  
RECOMENDED STEEL SUPPORT DRAWING.  
7. DIMENSIONS LISTED AS FOLLOWS:  
ENGLISH FT-IN  
[METRIC] MM  
8. PAN FLUME BOX EQUALIZERS SUPPLIED BY  
EVAPCO. PAN EQUALIZER PIPING IS SUPPLIED  
BY OTHERS.  
9. PAN EQUALIZER NIPPLE IS 11'-10 3/8" [3616]  
OFF EACH STEP SIDE.

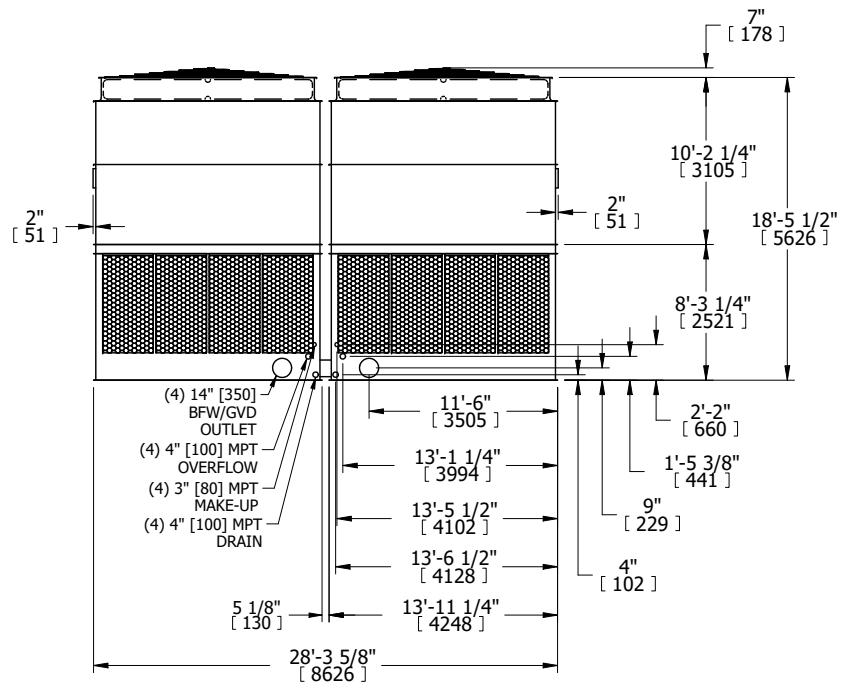

**PLAN VIEW**

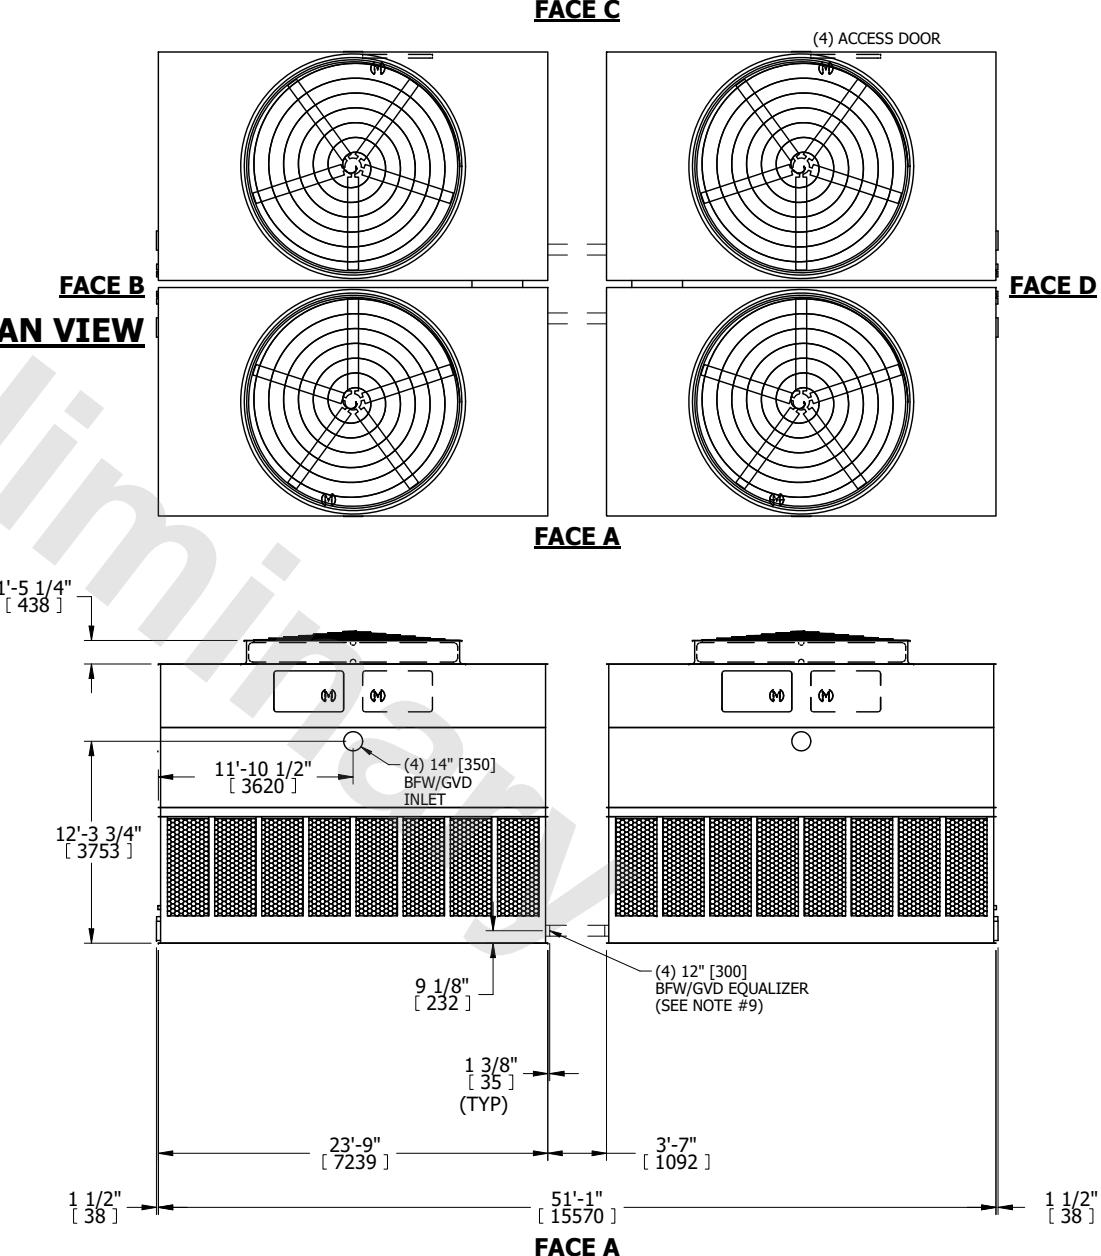

**FACE C**

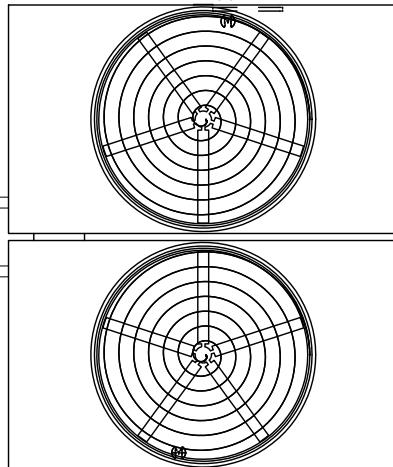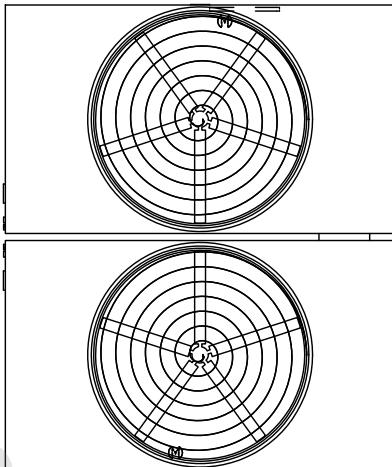

**FACE D**

SHIPPING WEIGHT	69440 lbs+ [31500] kg+	OPERATING WEIGHT	134120 lbs+ [60840] kg+	HEAVIEST SECTION WEIGHT	11640 lbs+ [5280] kg+	NO. OF SHIPPING SECTIONS	8	DRAWN BY: MER
-----------------	------------------------	------------------	-------------------------	-------------------------	-----------------------	--------------------------	---	---------------