
UNIT eco-ATWB-H 20-2M12-U22 TITLE STEEL SUPPORT CONFIGURATION

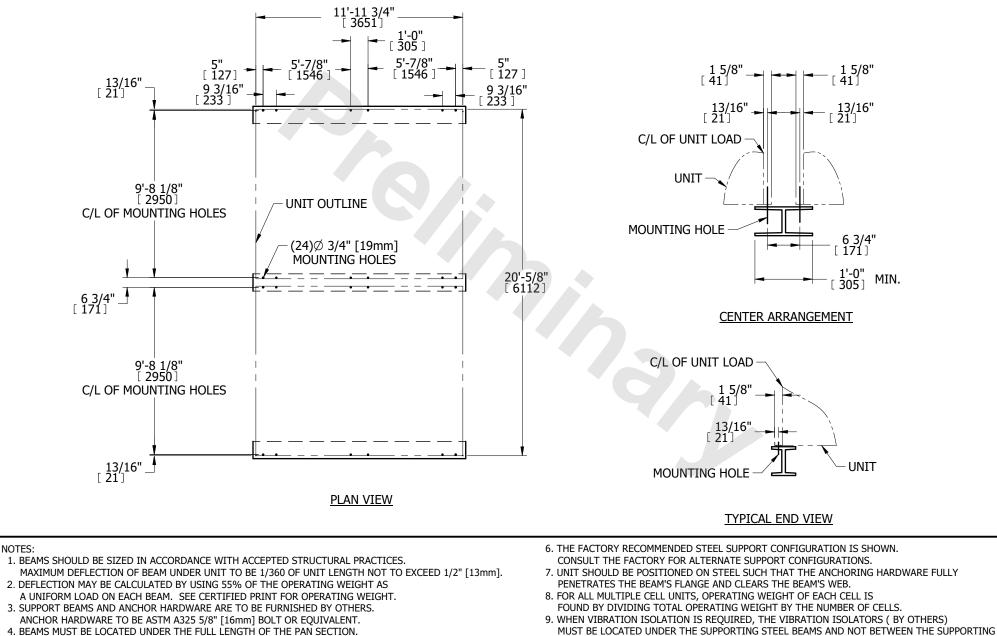

- 5. SUPPORTING BEAM SURFACE MUST BE LEVEL. DO NOT LEVEL THE UNIT BY
- PLACING SHIMS BETWEEN THE UNIT MOUNTING FLANGE AND THE SUPPORTING BEAM.

- STEEL BEAMS AND THE UNIT. 10.THE CENTER BEAM SHOULD HAVE A MINIMUM WIDTH OF 12" [305mm]
- 11. DIMENSIONS LISTED AS FOLLOWS: ENGLISH FT-IN

[METRIC] [mm]

DWG. #

SCALE

N.T.S.

SLAW6M12-DD

DRAWN BY

JLG