




UNIT	COOLING TOWER
MODEL #	AT 112-3K14

DWG. #	T3121436-DRE-ST	REV.	-
SERIAL #		DATE	1/31/2026


NOTES:
 1. (M) FAN MOTOR LOCATION
 2. HEAVIEST SECTION IS UPPER SECTION
 3. MPT DENOTES MALE PIPE THREAD
 FPT DENOTES FEMALE PIPE THREAD
 BFW DENOTES BEVELED FOR WELDING
 GVD DENOTES GROOVED
 FLG DENOTES FLANGE
 4. +UNIT WEIGHT DOES NOT INCLUDE
 ACCESSORIES (SEE ACCESSORY DRAWINGS)
 5. MAKE-UP WATER PRESSURE
 20 psi MIN [137 kPa], 50 psi MAX [344 kPa]
 6. 3/4" [19MM] DIA. MOUNTING HOLES.
 REFER TO RECOMMENDED STEEL SUPPORT
 DRAWING
 7. DIMENSIONS LISTED AS FOLLOWS:
 ENGLISH FT-IN
 [METRIC] [mm]

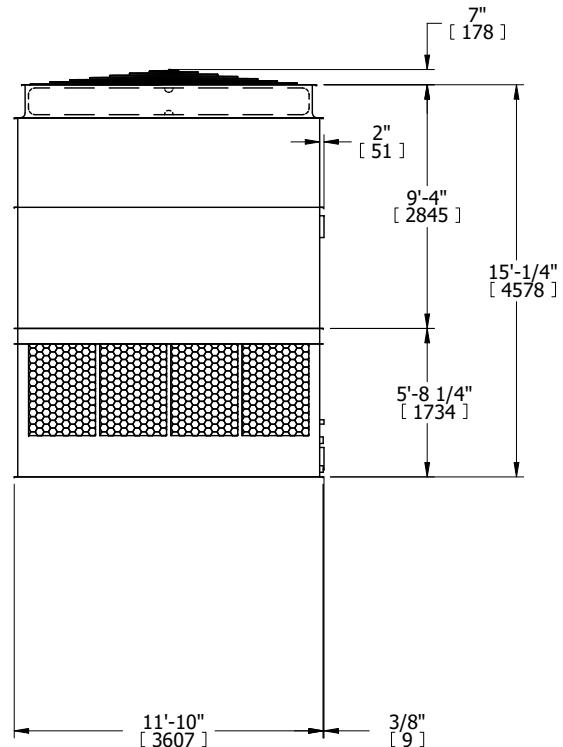

FACE B
PLAN VIEW

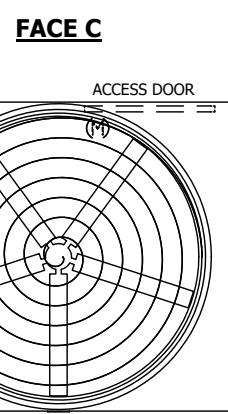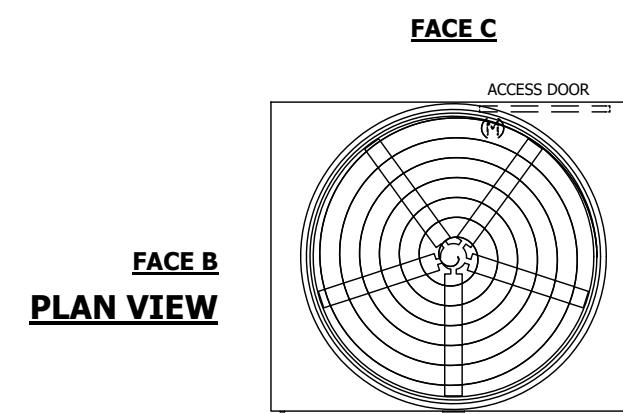

FACE D

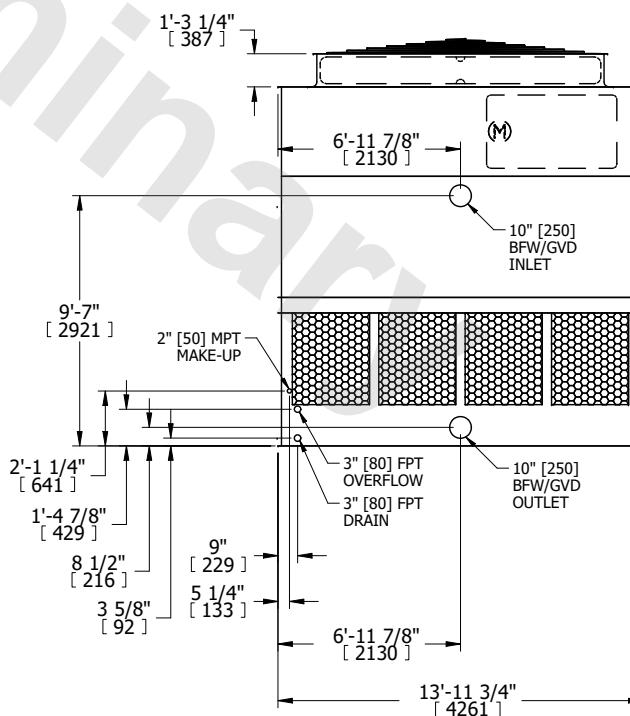

FACE A