


UNIT	COOLING TOWER		<b>EVAPCO, INC.</b> 	DWG. #	T4285260-DRA-ST	REV.
MODEL #	AT 428-5N52	SCALE NTS		SERIAL #		DATE 1/29/2026

- 1. (M)- FAN MOTOR LOCATION
- 2. HEAVIEST SECTION IS UPPER SECTION
- 3. MPT DENOTES MALE PIPE THREAD
- FPT DENOTES FEMALE PIPE THREAD
- BFW DENOTES BEVELED FOR WELDING
- GVD DENOTES GROOVED
- FLG DENOTES FLANGE
- PE DENOTES PLAIN END
- 4. +UNIT WEIGHT DOES NOT INCLUDE  
ACCESSORIES (SEE ACCESSORY DRAWINGS)
- 5. MAKE-UP WATER PRESSURE  
20 psi MIN [137 kPa], 50 psi MAX [344 kPa]
- 6. 3/4" [19MM] DIA. MOUNTING HOLES.  
REFER TO RECOMMENDED STEEL SUPPORT  
DRAWING
- 7. DIMENSIONS LISTED AS FOLLOWS:  
ENGLISH FT-IN  
[METRIC] [mm]
- 8. PAN FLUME BOX EQUALIZERS SUPPLIED BY  
EVAPCO. PAN EQUALIZER PIPING IS SUPPLIED  
BY OTHERS.
- 9. PAN EQUALIZER NIPPLE IS 11'-10 3/8" [3616]  
OFF EACH STEP SIDE.

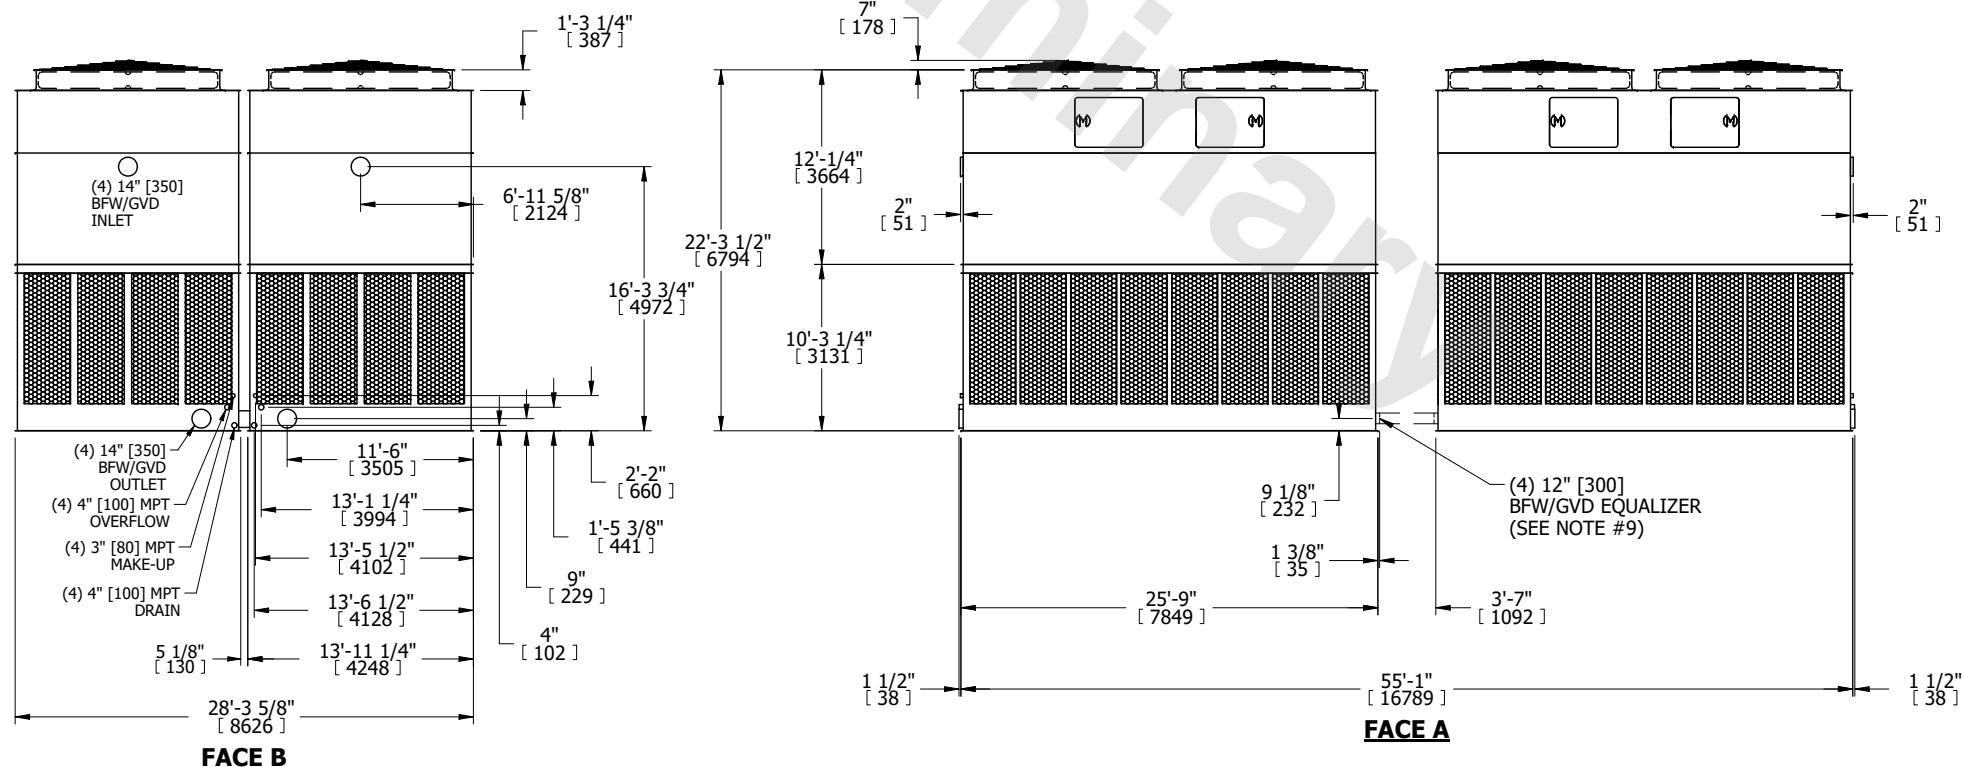

SHIPPING WEIGHT 99120 lbs+ [44965] kg+ OPERATING WEIGHT 166440 lbs+ [75500] kg+ HEAVIEST SECTION WEIGHT 18140 lbs+ [8230] kg+ NO. OF SHIPPING SECTIONS 8 DRAWN BY: MER