

EVAPCO, INC.




TITLE
SLOPED LADDER INSTALLATION PACKAGE


UNIT:

DWG. #

LDRP1711DA

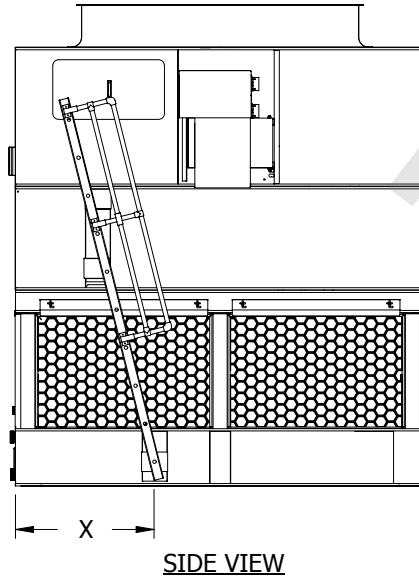

LADDER SHIPS
LOOSE FOR FIELD
MOUNTING
(BY OTHERS)

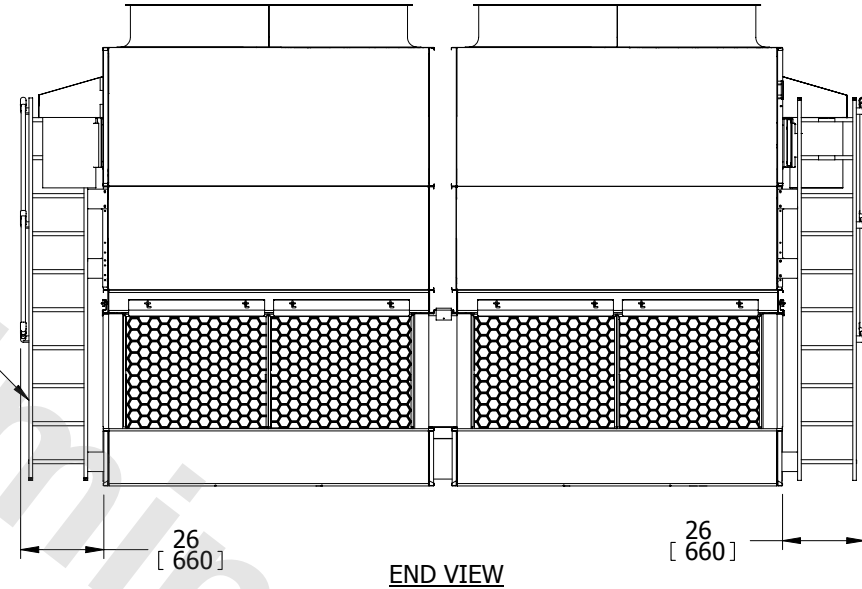

NOTE:

1. REFER TO RIGGING PACK FOR LADDER AND PLATFORM MOUNTING INSTRUCTIONS.

RIG LADDER BEFORE PIPING UNIT

* THE BOTTOM OF THE LADDER IS AT THE BASE OF THE UNIT.
IF THE UNIT IS ELEVATED THEN A LADDER EXTENSION SHOULD
BE CONSIDERED. (CONSULT FACTORY).
LADDER EXTENSIONS OF UP TO 3 FEET CAN BE ADDED WITHOUT
ANY ADDITIONAL SUPPORT. FOR A LADDER EXTENSION LONGER
THAN 3 FEET ADDITIONAL SUPPORT MUST BE PROVIDED BY OTHERS.

MODEL #	DIM. X	
	IN.	MM
REP 217-111, 411	42 7/16	1078
REP 217-211, 311, 611, 811	44 5/8	1133
REP 217-511, 711, 911	48 3/8	1229

CUSTOMER INSTALLATION NOTES:

- a. REMOVE LADDER BRACKET MOUNTING BOLTS (1) FROM LADDER MOUNTING CHANNELS (2) ON PAN AND CASING SECTIONS.
- b. LOOSEN, BUT DO NOT REMOVE, LADDER BRACKET AND ASSY. BOLTS (3).
- c. TO ASSEMBLE, SLIDE LADDER BRACKET ASSY. (4) OVER LADDER MOUNTING CHANNELS (2) LOCATED ON PAN AND CASING (DO NOT REMOVE LADDER BRACKET ASSY. (4) FROM LADDER.)
- d. ALIGN HOLES AND REINSTALL LADDER BRACKET MOUNTING BOLTS (1) THROUGH LADDER BRACKET ASSY. (4) AND LADDER MOUNTING CHANNELS (2).
- e. TIGHTEN ALL BOLTS.
- f. TIGHTEN ADJUSTING SCREW (5) IN THE ADJUSTABLE MOUNTING BRACKETS WHEN APPLICABLE.

