
ATC-DC-2418M-25-2EF

UNIT

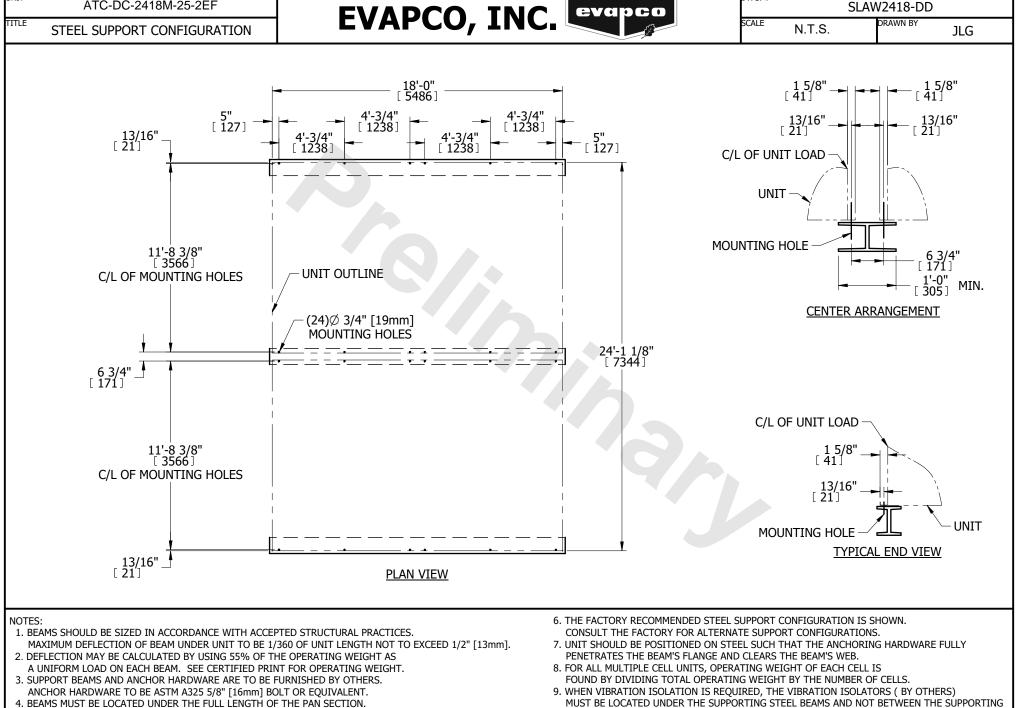

- 5. SUPPORTING BEAM SURFACE MUST BE LEVEL. DO NOT LEVEL THE UNIT BY
- PLACING SHIMS BETWEEN THE UNIT MOUNTING FLANGE AND THE SUPPORTING BEAM.

- MUST BE LOCATED UNDER THE SUPPORTING STEEL BEAMS AND NOT BETWEEN THE SUPPORTING STEEL BEAMS AND THE UNIT.
- 10.THE CENTER BEAM SHOULD HAVE A MINIMUM WIDTH OF 12" [305mm]
- 11. DIMENSIONS LISTED AS FOLLOWS: ENGLISH FT-IN
 - [METRIC] [mm]

DWG. #

SLAW2418-DD