


UNIT	COOLING TOWER
MODEL #	AT 19-3K14

DWG. #	T3091436-DRD-ST	REV.	-
SERIAL #		DATE	2/13/2026


NOTES:  
1. (M) - FAN MOTOR LOCATION  
2. HEAVIEST SECTION IS UPPER SECTION  
3. MPT DENOTES MALE PIPE THREAD  
FPT DENOTES FEMALE PIPE THREAD  
BFW DENOTES BEVELED FOR WELDING  
GVD DENOTES GROOVED  
FLG DENOTES FLANGE  
4. +UNIT WEIGHT DOES NOT INCLUDE  
ACCESSORIES (SEE ACCESSORY DRAWINGS)  
5. MAKE-UP WATER PRESSURE  
20 psi MIN [137 kPa], 50 psi MAX [344 kPa]  
6. 3/4" [19MM] DIA. MOUNTING HOLES. REFER TO  
RECOMENDED STEEL SUPPORT DRAWING.  
7. DIMENSIONS LISTED AS FOLLOWS:  
ENGLISH FT-IN  
[METRIC] [mm]

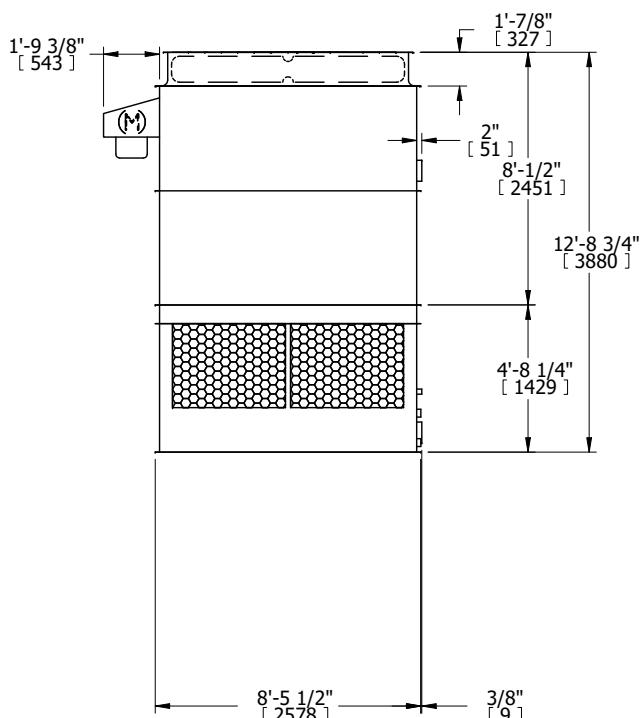

**FACE B**


**PLAN VIEW**

**FACE C**

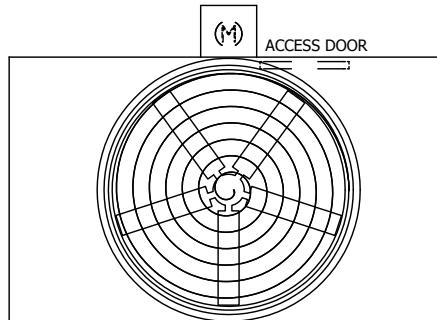

**FACE D**

**FACE A**

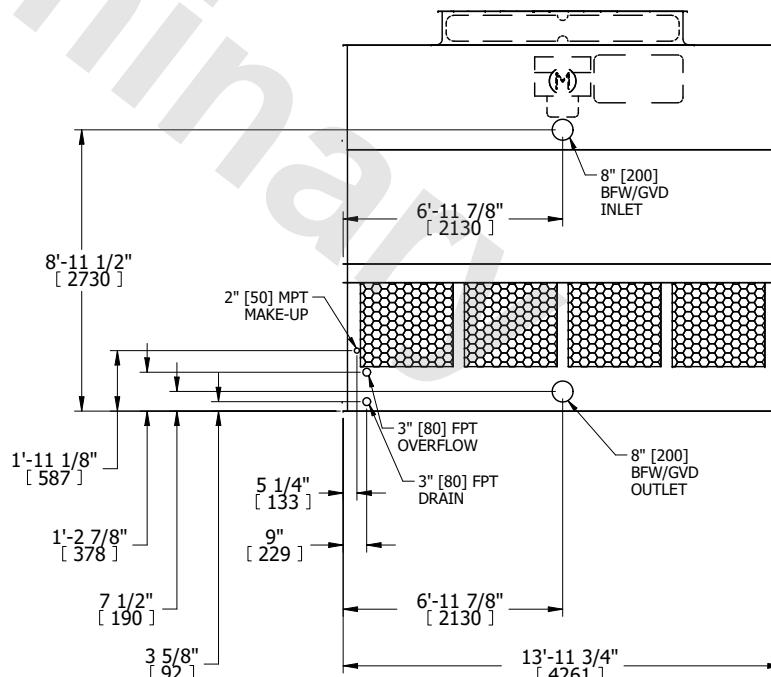

**FACE A**