


UNIT	COOLING TOWER
MODEL #	AT 17-3118

DWG. #	CT4C071836-DRA-ST	REV.
SERIAL #		DATE 2/10/2026

NOTES:  
 1. (M) - FAN MOTOR LOCATION  
 2. HEAVIEST SECTION IS FAN/CASING SECTION  
 3. MPT DENOTES MALE PIPE THREAD  
 FPT DENOTES FEMALE PIPE THREAD  
 BFW DENOTES BEVELED FOR WELDING  
 GVD DENOTES GROOVED  
 FLG DENOTES FLANGE  
 4. +UNIT WEIGHT DOES NOT INCLUDE  
 ACCESSORIES (SEE ACCESSORY DRAWINGS)  
 5. 3/4" [19MM] DIA. MOUNTING HOLES.  
 REFER TO RECOMMENDED STEEL  
 SUPPORT DRAWING  
 6. DIMENSIONS LISTED AS FOLLOWS:  
 ENGLISH FT-IN  
 [METRIC] [mm]  
 7. MAKE-UP WATER PRESSURE  
 20 psi MIN [137 kPa], 50 psi MAX [344 kPa]

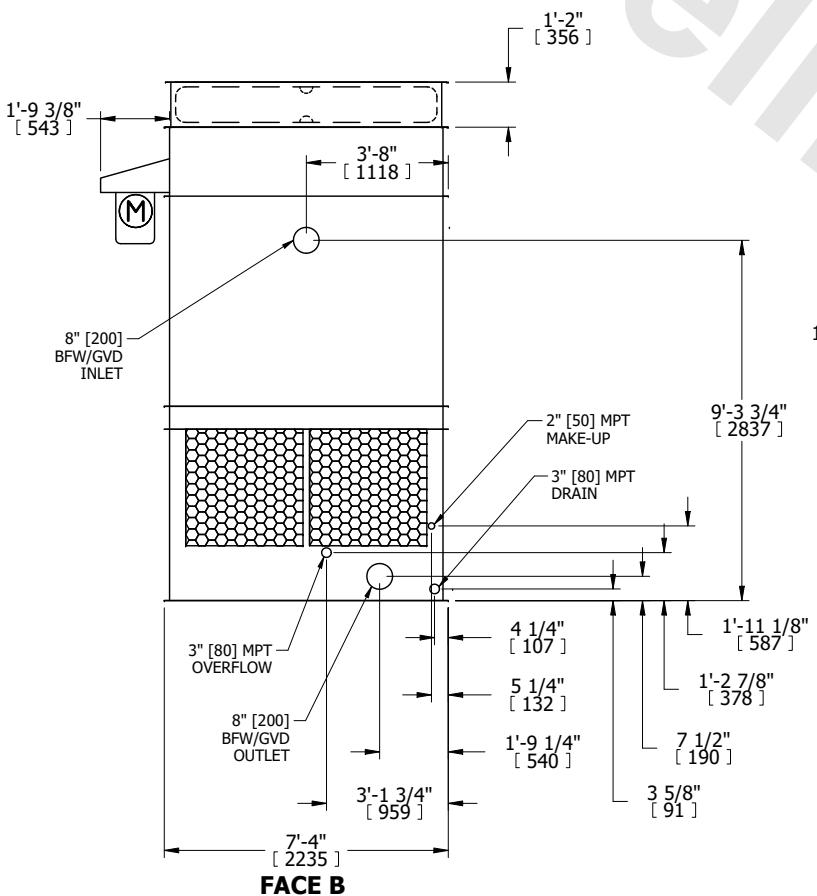

**PLAN VIEW**

