


STEEL SUPPORT CONFIGURATION

UNIT

TITLE

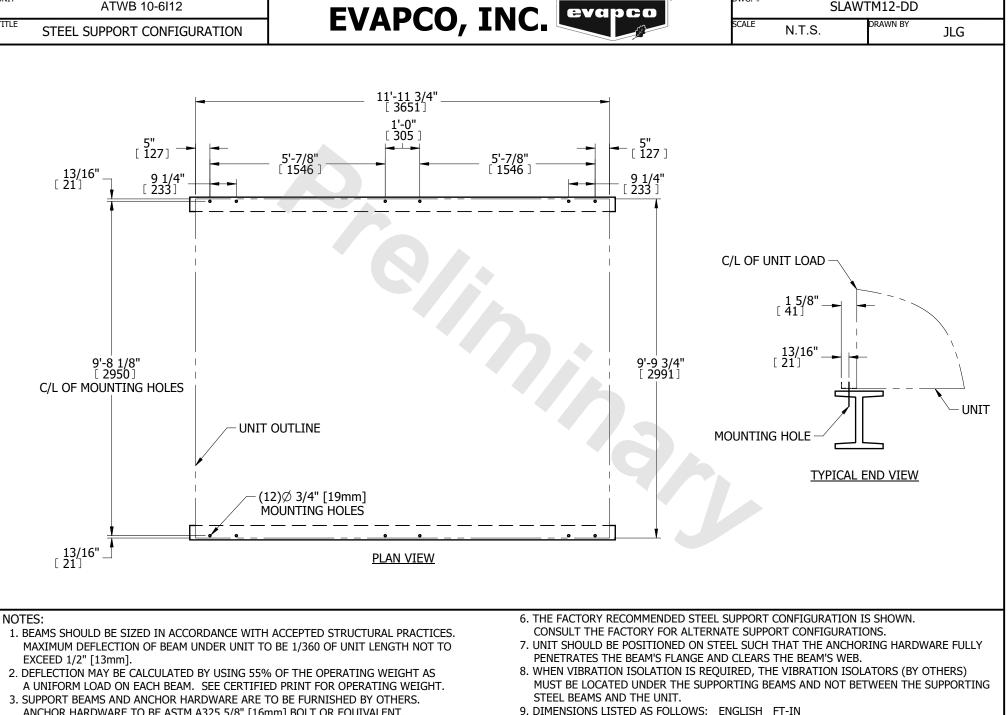

DWG. #

SCALE

[METRIC] [mm]

SLAWTM12-DD

DRAWN BY

ANCHOR HARDWARE TO BE ASTM A325 5/8" [16mm] BOLT OR EQUIVALENT. 4. BEAMS MUST BE LOCATED UNDER THE FULL LENGTH OF THE PAN SECTION.

- 5. SUPPORTING BEAM SURFACE MUST BE LEVEL. DO NOT LEVEL THE UNIT BY
- PLACING SHIMS BETWEEN THE UNIT MOUNTING FLANGE AND THE SUPPORTING BEAM.