
ATWB 4-5E4-Z

UNIT

TITLE

STEEL SUPPORT CONFIGURATION

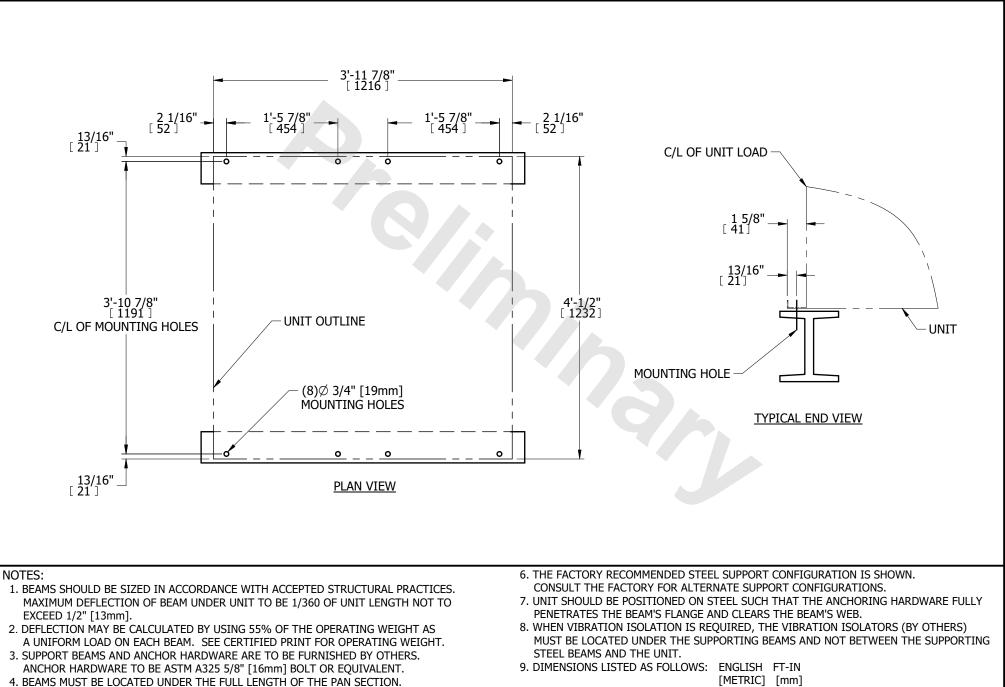

EVAPCO, INC.

- 5. SUPPORTING BEAM SURFACE MUST BE LEVEL. DO NOT LEVEL THE UNIT BY
- PLACING SHIMS BETWEEN THE UNIT MOUNTING FLANGE AND THE SUPPORTING BEAM.
- [METRIC] [mm]

DWG. #

SCALE

N.T.S.

SLAW30404-DD

DRAWN BY

JLG