



UNIT	COOLING TOWER
MODEL #	AT 39-3M42

DWG. #	T3094236-DRD-ST	REV.	-
SERIAL #		DATE	2/9/2026


NOTES:

1. (M)- FAN MOTOR LOCATION
2. HEAVIEST SECTION IS UPPER SECTION
3. MPT DENOTES MALE PIPE THREAD
- FPT DENOTES FEMALE PIPE THREAD
- BFW DENOTES BEVELED FOR WELDING
- GVD DENOTES GROOVED
- FLG DENOTES FLANGE
4. +UNIT WEIGHT DOES NOT INCLUDE  
ACCESSORIES (SEE ACCESSORY DRAWINGS)
5. MAKE-UP WATER PRESSURE  
20 psi MIN [137 kPa], 50 psi MAX [344 kPa]
6. 3/4" [19MM] DIA. MOUNTING HOLES. REFER TO  
RECOMMENDED STEEL SUPPORT DRAWING.
7. DIMENSIONS LISTED AS FOLLOWS:  
ENGLISH FT-IN  
[METRIC] [mm]


**FACE B**  
**PLAN VIEW**

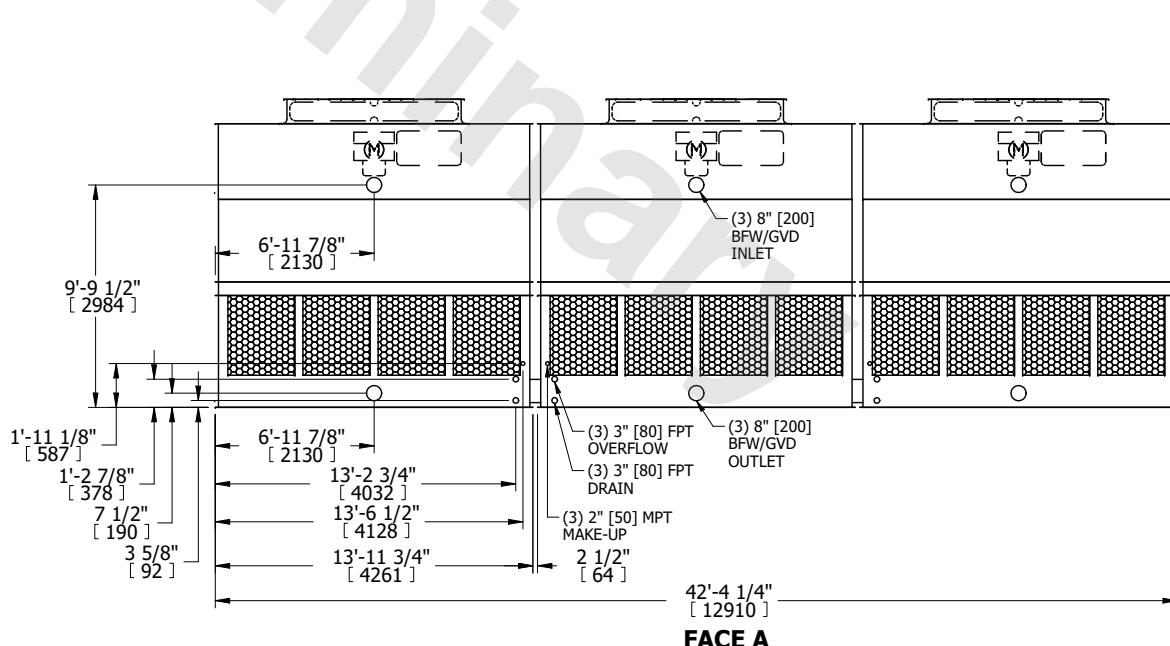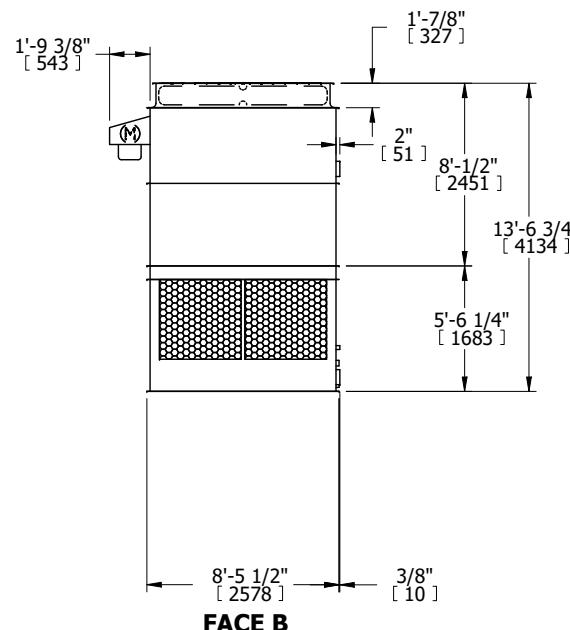

**FACE C**

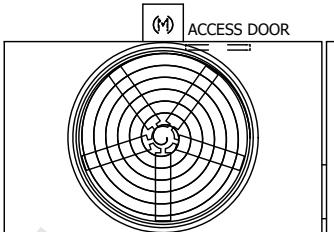

**FACE D**



**FACE A**