


UNIT	COOLING TOWER
MODEL #	AT 342-5L26

DWG. #	T3BI422660-DRD-ST	REV.	-
SERIAL #		DATE	2/10/2026

NOTES:



- (M)- FAN MOTOR LOCATION
- HEAVIEST SECTION IS UPPER SECTION
- MPT DENOTES MALE PIPE THREAD
- FPT DENOTES FEMALE PIPE THREAD
- BFW DENOTES BEVELED FOR WELDING
- GVD DENOTES GROOVED
- FLG DENOTES FLANGE
- +UNIT WEIGHT DOES NOT INCLUDE ACCESSORIES (SEE ACCESSORY DRAWINGS)
- MAKE-UP WATER PRESSURE  
20 psi MIN [137 kPa], 50 psi MAX [344 kPa]
- PAN EQUALIZER PIPING IS SUPPLIED BY OTHERS, FLUME SUPPLIED BY EVAPCO.
- FOR BOTTOM CONNECTION SPECIFICATIONS, SEE DETAIL.
- 3/4" [19mm] DIA. MOUNTING HOLES. REFER TO RECOMMENDED STEEL SUPPORT DRAWING
- DIMENSIONS LISTED AS FOLLOWS:

ENGLISH FT-IN  
[METRIC] [mm]

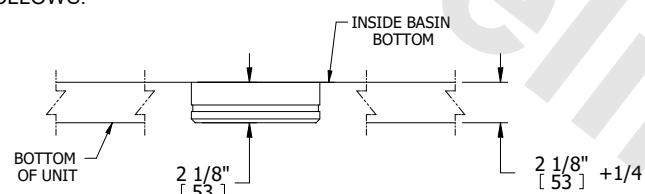


**TYPICAL BOTTOM CONNECTION DETAIL**

**PLAN VIEW**

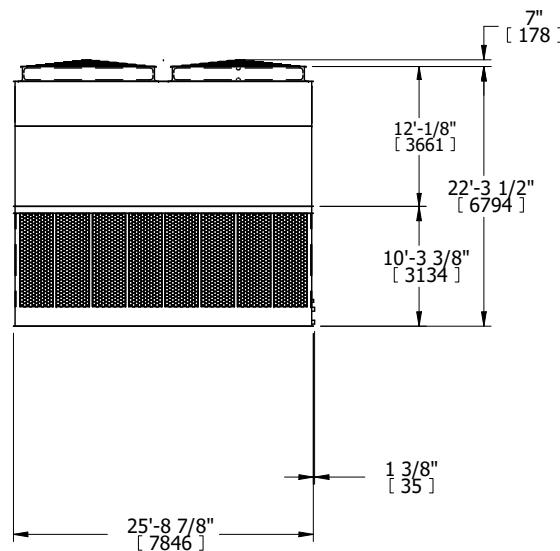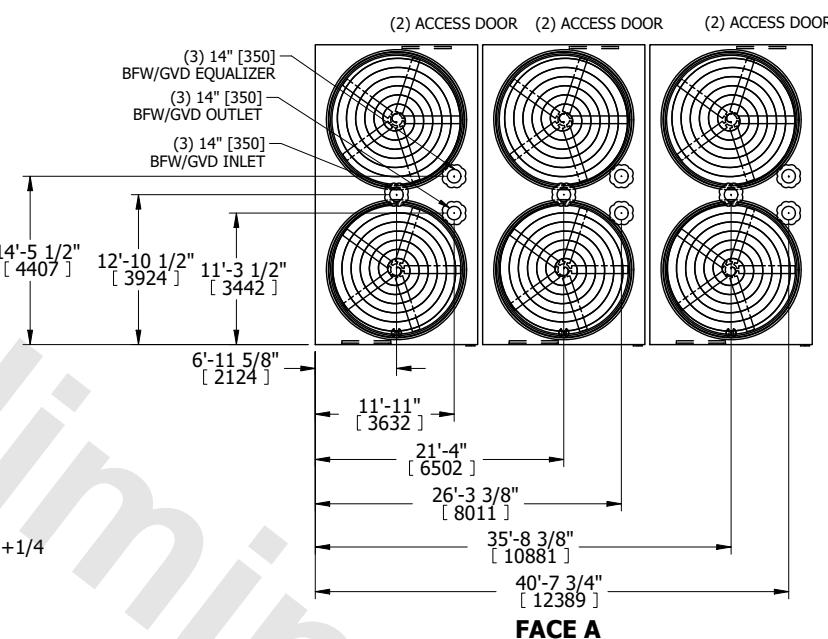

**FACE B**

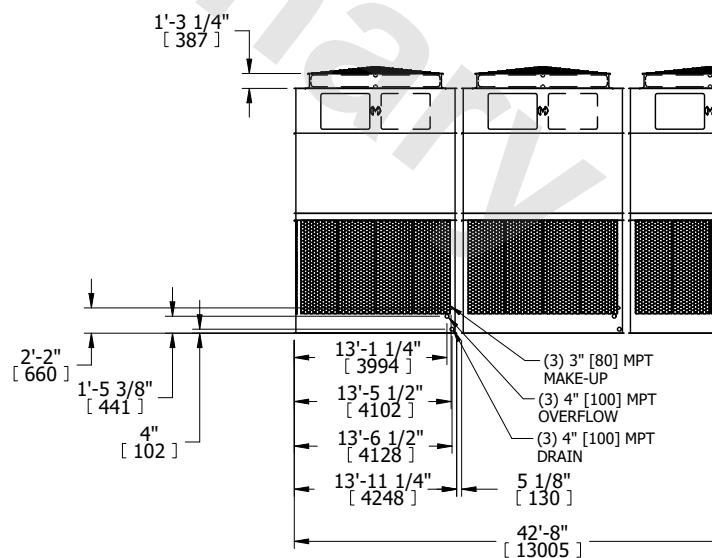

**FACE A**