
ATWB 12-3L14-Z

UNIT

STEEL SUPPORT CONFIGURATION

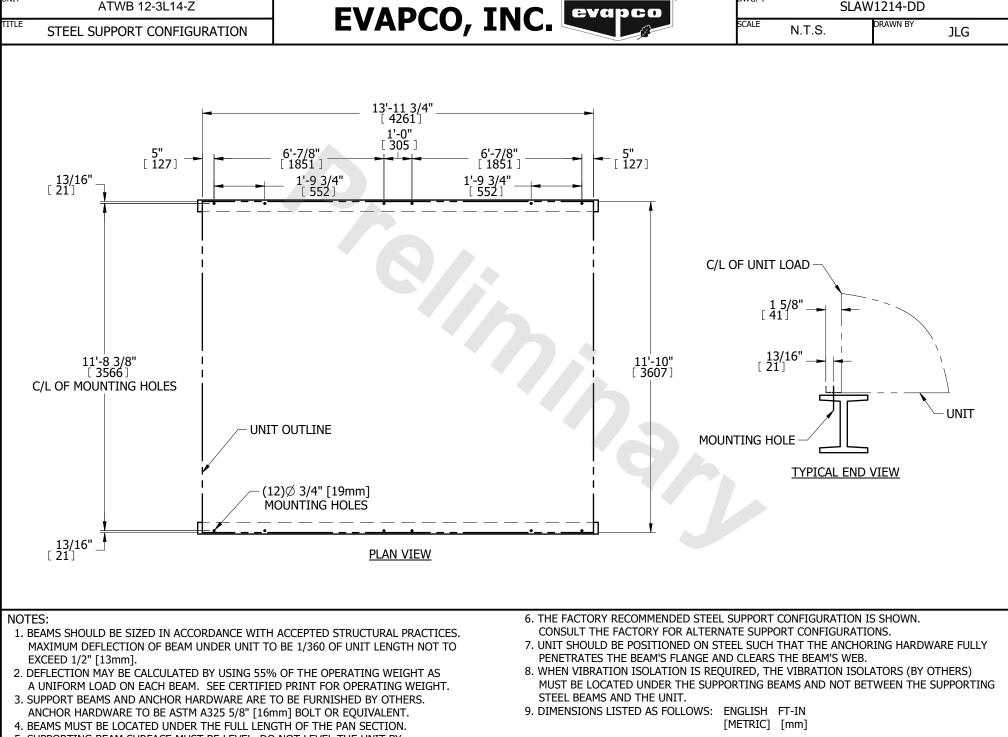

DWG. #

SLAW1214-DD

5. SUPPORTING BEAM SURFACE MUST BE LEVEL. DO NOT LEVEL THE UNIT BY PLACING SHIMS BETWEEN THE UNIT MOUNTING FLANGE AND THE SUPPORTING BEAM.