
eco-ATWB-H 10-3I12-U22

UNIT

TITLE

STEEL SUPPORT CONFIGURATION

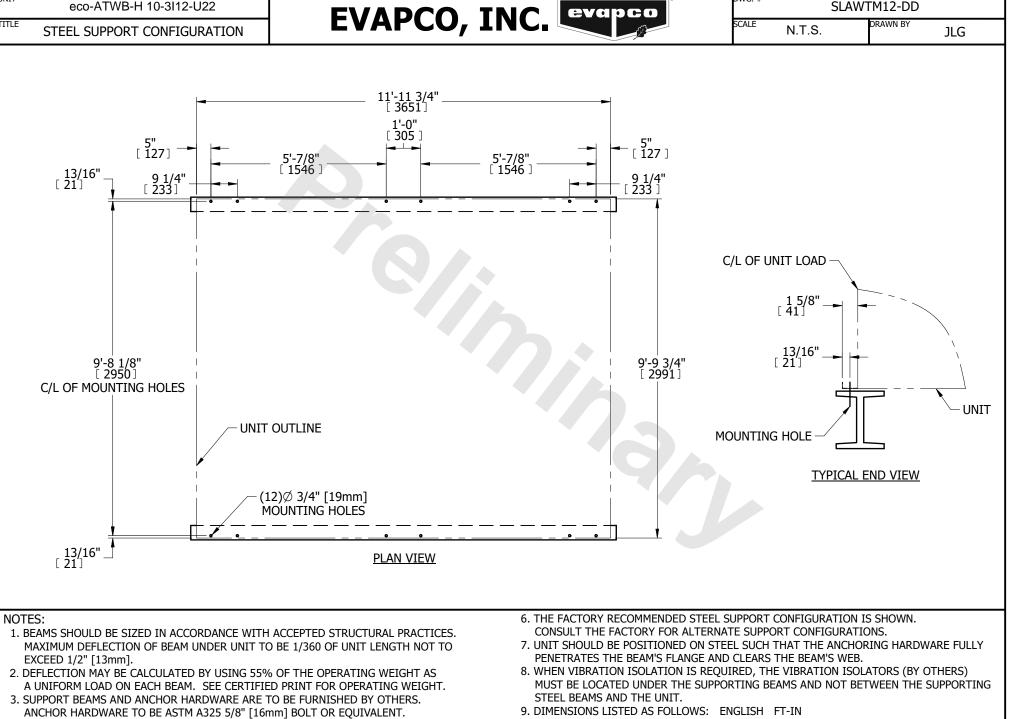

- 4. BEAMS MUST BE LOCATED UNDER THE FULL LENGTH OF THE PAN SECTION.
- 5. SUPPORTING BEAM SURFACE MUST BE LEVEL. DO NOT LEVEL THE UNIT BY
- PLACING SHIMS BETWEEN THE UNIT MOUNTING FLANGE AND THE SUPPORTING BEAM.
- [METRIC] [mm]

DWG. #

SCALE

SLAWTM12-DD

DRAWN BY