



UNIT	COOLING TOWER
MODEL #	AXS 12-19I22

NOTES:  
 1. (M) FAN MOTOR LOCATION  
 2. HEAVIEST SECTION IS UPPER SECTION  
 3. MPT DENOTES MALE PIPE THREAD  
 FPT DENOTES FEMALE PIPE THREAD  
 BFW DENOTES BEVELED FOR WELDING  
 GVD DENOTES GROOVED  
 4. +UNIT WEIGHT DOES NOT INCLUDE  
 ACCESSORIES (SEE ACCESSORY DRAWINGS)  
 5. MAKE-UP WATER PRESSURE  
 20 psi MIN [137 kPa], 50 psi MAX [344 kPa]  
 6. 3/4" DIA. MOUNTING HOLES. REFER TO  
 RECOMMENDED STEEL SUPPORT DRAWING.  
 7. DIMENSIONS LISTED AS FOLLOWS: ENGLISH IN  
 [METRIC] [mm]

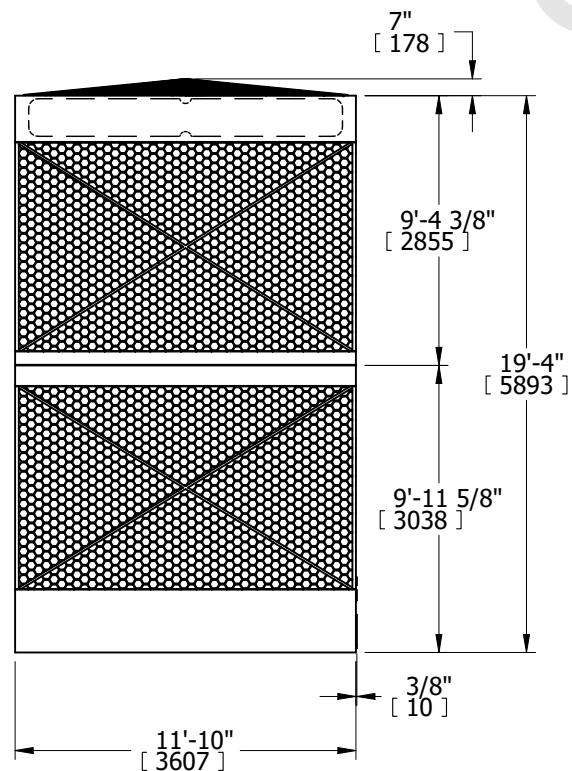

**FACE B**


**PLAN VIEW**

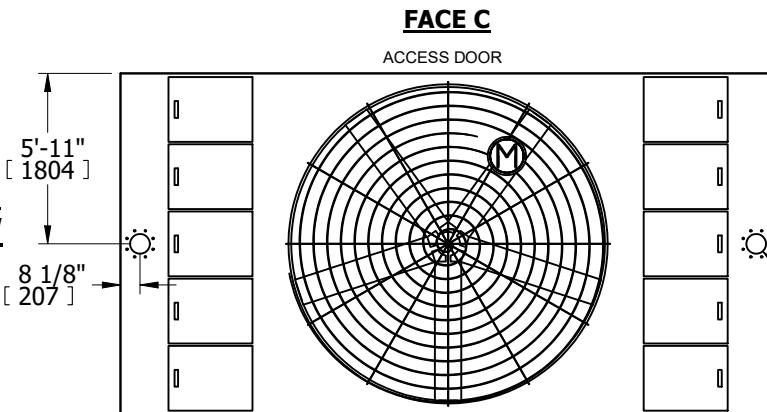

**FACE C**

**FACE D**

**FACE A**

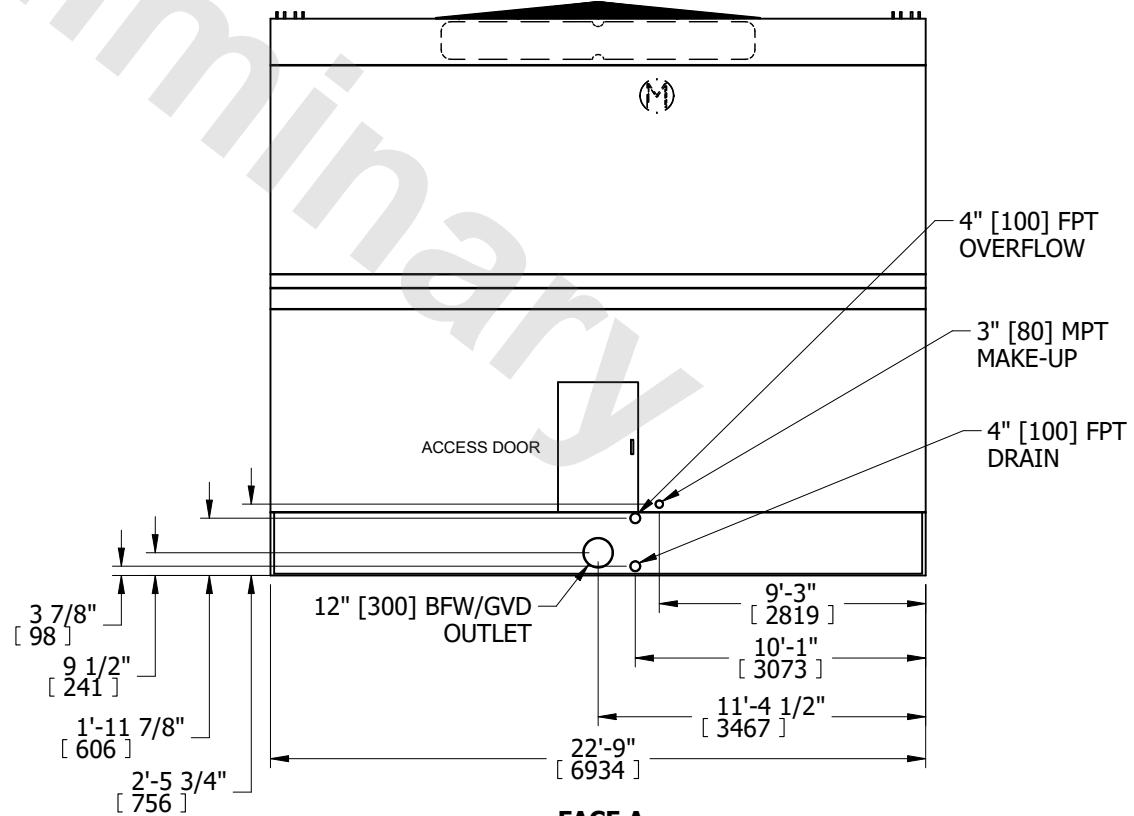

**FACE A**