
ESW4 9-45H18-LP-Z TITLE STEEL SUPPORT CONFIGURATION

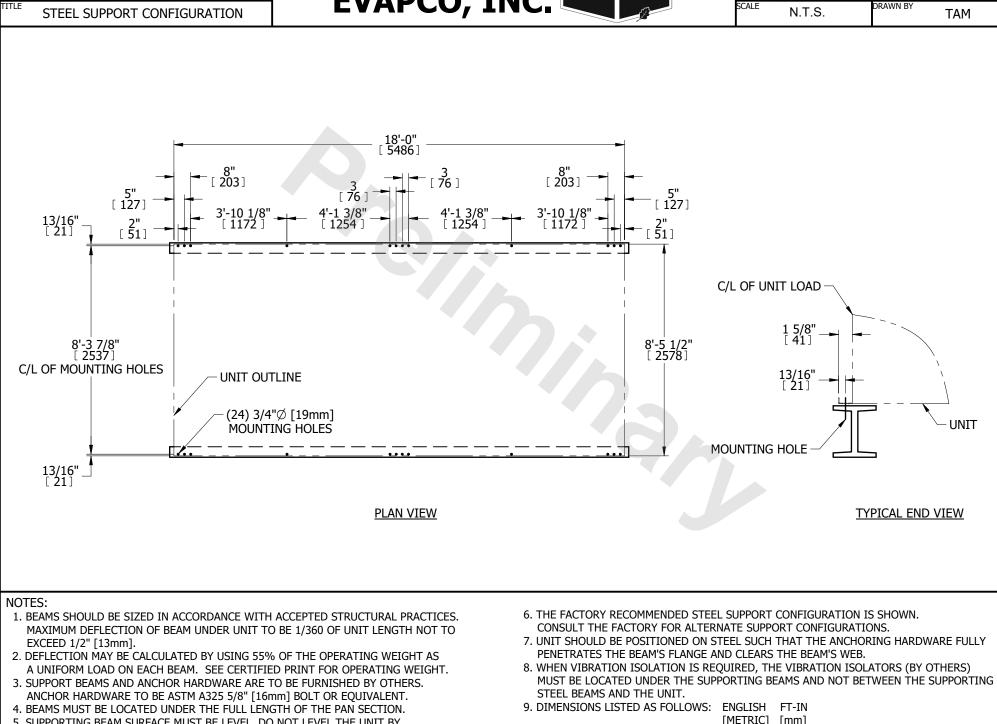

5. SUPPORTING BEAM SURFACE MUST BE LEVEL. DO NOT LEVEL THE UNIT BY PLACING SHIMS BETWEEN THE UNIT MOUNTING FLANGE AND THE SUPPORTING BEAM.

DWG. #

SLWX40918-DA